




MONTH, YEAR
CHINA

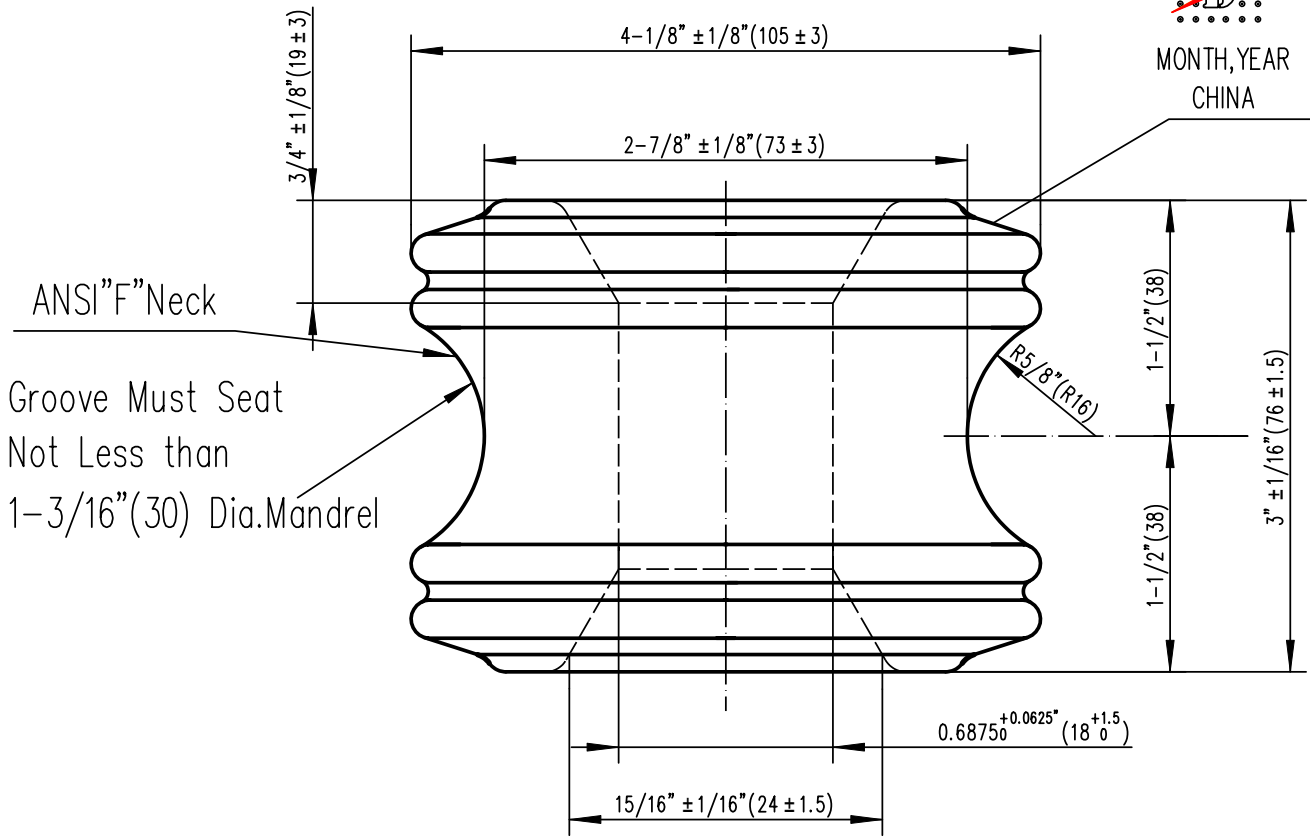

NOTE:

- | | |
|---|----------------|
| 1. Transverse Strength | 89000lbs(20kN) |
| 2. Low Frequency Flashover (Dry) | 25kV |
| 3. Vertical Low Frequency Flashover (Wet) | 12kV |
| 4. Horizontal Low Frequency Flashover (Wet) | 15kV |
| 5. Applicable Standard ANSI C29.3-1986. | |

General Tolerance			DP 53-4 SPOOL INSULATOR (ANSI 53-4)				
<30	±1.5	ANGLE:					
>30	±5%						
Drawn	David Shao	Sep.29,2005	DULHUNTY POWER	Mass		Scale	N/S
Checked				A4-6078	REV	B	
Approved							